

# HALLMARK BUILDING SUPPLIES INC. WINDLOAD TEST REPORT

## SCOPE OF WORK

ASTM D5206 WINDLOAD TESTING ON LSM-619 SELF-MATING PANELS LEVANTE SIDING

## REPORT NUMBER

J3219.01-109-40

## TEST DATE(S)

06/27/19

## ISSUE DATE

09/09/19

## RECORD RETENTION END DATE

06/27/23

## PAGES


10

## DOCUMENT CONTROL NUMBER

ATI 00500 (07/24/17)

RT-R-AMER-Test-2808

© 2017 INTERTEK

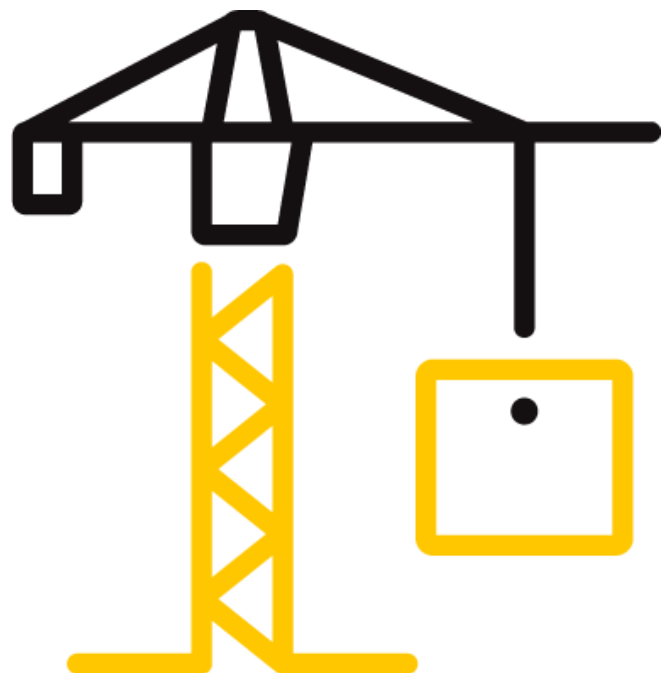



Total Quality. Assured.

130 Derry Court  
York, Pennsylvania 17406

Telephone: 717-764-7700  
Facsimile: 717-764-4129  
www.intertek.com/building

## TEST REPORT FOR HALLMARK BUILDING SUPPLIES INC.

Report No.: J3219.01-109-40

Date: 09/09/19

### REPORT ISSUED TO

**HALLMARK BUILDING SUPPLIES, INC.**

2120 Pewaukee Road, Suite 100

Waukesha, Wisconsin 53188

### SECTION 1

#### SCOPE

Intertek Building & Construction (B&C) was contracted by Hallmark Building Supplies, Inc. to perform windload testing in accordance with ASTM D5206 on their LSM-619 Self-Mating Panels, Levante siding. Results obtained are tested values and were secured by using the designated test method. Testing was conducted at Intertek B&C test facility in York, Pennsylvania.

This report does not constitute certification of this product nor an opinion or endorsement by this laboratory.

### SECTION 2

#### SUMMARY OF TEST RESULTS

**Product Type:** Siding

**Series/Model:** LSM-619 Self-Mating Panels, Levante

**Average Maximum Sustained Negative Pressure:** 125.0 psf

**Average Ultimate Negative Test Pressure:** 130.0 psf

For INTERTEK B&C:

<b>COMPLETED BY:</b>	John A. Shanabrook
<b>TITLE:</b>	Technician – Product Testing
<b>SIGNATURE:</b>	
<b>DATE:</b>	09/09/19

<b>REVIEWED BY:</b>	Timothy J. McGill
<b>TITLE:</b>	Manager – Product Testing
<b>SIGNATURE:</b>	
<b>DATE:</b>	09/09/19

JAS:wnl

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample(s) tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.

## TEST REPORT FOR HALLMARK BUILDING SUPPLIES INC.

Report No.: J3219.01-109-40

Date: 09/09/19

### SECTION 3

#### TEST METHOD(S)

The specimen was evaluated in accordance with the following:

**ASTM D5206-13**, *Standard Test Method for Windload Resistance of Rigid Plastic Siding*

### SECTION 4

#### MATERIAL SOURCE/INSTALLATION

The specimens were selected by Intertek B&C personnel. The specimens were witnessed during production and tagged prior to shipment on 04/01/19, (Reference Intertek B&C Test Specimen Selection Report No. J3219.02-103-15, dated 04/01/19). Representative samples of the test specimen will be retained by Intertek B&C for a minimum of four years from the test completion date.

The specimen was installed into test buck measuring 4' 1-1/2" wide by 6' high constructed of #2 Spruce-Pine-Fir nominal 2x4 lumber. Two studs were spaced 16" on center (three spans) and were attached to the top and bottom plates with 3" long drywall screws. The right center stud was reinforced with an additional nominal 2x4 stud sistered into place per client request. A sheet of nominal 1/2" thick OSB, with five 4" diameter holes to allow pressure to transfer to the siding, was secured to the studs with #8 x 1-5/8" drywall screws. Silicone was utilized on the backside of the test panel to seal the perimeter. A 2 mil thick plastic film was loosely draped over the interior of the siding to enable attainment of pressure.

The siding was mounted with #8 x 1-5/8" lath self-tapping screws, spaced 16" on center through the sheathing and into the studs with two fasteners per stud set 4" apart.

### SECTION 5

#### EQUIPMENT

Tape Measure Verification: 63788

Control Panel: 005406

Weather Station: 63317

### SECTION 6

#### LIST OF OFFICIAL OBSERVERS

NAME	COMPANY
Michael Hoium	Hallmark Building Supplies, Inc.
Timothy J. McGill	Intertek B&C
John A. Shanabrook	Intertek B&C

## TEST REPORT FOR HALLMARK BUILDING SUPPLIES INC.

Report No.: J3219.01-109-40

Date: 09/09/19

### SECTION 7

#### TEST SPECIMEN DESCRIPTION

<b>MANUFACTURER</b>	Levanté, LLC
<b>SERIES/MODEL</b>	LSM-619 Self-mating panels, Levante
<b>PRODUCT TYPE</b>	Aluminum siding
<b>MATERIAL TYPE</b>	Aluminum
<b>NOMINAL THICKNESS</b>	0.087"
<b>MEASURED THICKNESS</b>	0.087"
<b>EXTERIOR FINISH</b>	Flat

Each specimen consisted of four horizontal courses of panels mounted independently of one another. A vertical transition strip was installed in the second and third courses over the sistered stud.

### SECTION 8

#### TEST RESULTS

The temperature during testing was 29°C (85°F). The results are tabulated as follows:

**General Note:** All loads were negative pressure and were held for thirty seconds. A 5.0 psf pre-load was applied before running specimens to failure.

##### Test Specimen #1:

PRESSURE	RESULTS
10.0 psf to 125.0 psf	No damage
130.0 psf	Testing stopped due to the wall design

##### Test Specimen #2:

PRESSURE	RESULTS
10.0 psf to 125.0 psf	No damage
130.0 psf	Testing stopped due to the wall design

##### Test Specimen #3:

PRESSURE	RESULTS
10.0 psf to 125.0 psf	No damage
130.0 psf	Testing stopped due to the wall design



Total Quality. Assured.

130 Derry Court  
York, Pennsylvania 17406

Telephone: 717-764-7700  
Facsimile: 717-764-4129  
[www.intertek.com/building](http://www.intertek.com/building)

## TEST REPORT FOR HALLMARK BUILDING SUPPLIES INC.

Report No.: J3219.01-109-40

Date: 09/09/19

### SECTION 9

#### CONCLUSION

The specimen(s) tested successfully achieved an Average Maximum Sustained Negative Pressure of 125.0 psf and an Average Ultimate Negative Test Pressure of 130.0 psf.

Testing was stopped due to pressure limits on the testing wall being reached.

## TEST REPORT FOR HALLMARK BUILDING SUPPLIES INC.

Report No.: J3219.01-109-40

Date: 09/09/19

### SECTION 10

#### PHOTOGRAPHS



**Photo No. 1**  
**Specimen #1 Prior to Testing**



**Photo No. 2**  
**Specimen #2 Prior to Testing**

**TEST REPORT FOR HALLMARK BUILDING SUPPLIES INC.**

Report No.: J3219.01-109-40

Date: 09/09/19



**Photo No. 3**  
**Specimen #3 Prior to Testing**



Total Quality. Assured.

130 Derry Court  
York, Pennsylvania 17406

Telephone: 717-764-7700  
Facsimile: 717-764-4129  
[www.intertek.com/building](http://www.intertek.com/building)

## **TEST REPORT FOR HALLMARK BUILDING SUPPLIES INC.**

Report No.: J3219.01-109-40

Date: 09/09/19

### **SECTION 11**



#### **DRAWINGS**

The test specimen drawings have been reviewed by Intertek B&C and are representative of the test specimens reported herein. Test specimen construction was verified by Intertek B&C per the drawings included in this report. Any deviations are documented herein or on the drawings.

LSM619



Report #

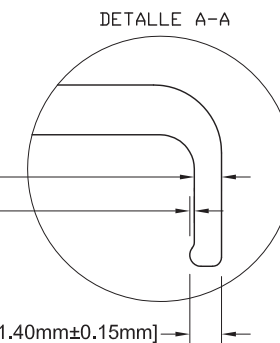

LEVANTÉ  
PREMIER ALUMINUM EXTERIOR

LSM619



Total Quality. Assured.

130 Derry Court  
York, Pennsylvania 17406

Telephone: 717-764-7700  
Facsimile: 717-764-4129  
[www.intertek.com/building](http://www.intertek.com/building)

## TEST REPORT FOR HALLMARK BUILDING SUPPLIES INC.

Report No.: J3219.01-109-40

Date: 09/09/19

### SECTION 12

#### REVISION LOG

REVISION #	DATE	PAGES	REVISION
0	09/09/19	N/A	Original Report Issue